


A photograph of a modern glass building with a network diagram overlay. The diagram consists of light blue circles connected by thin lines, forming a complex web. The building has a curved facade and is set against a blue sky with light clouds. In the foreground, there is a metal railing and a road with a black and white striped curb. A green diagonal shape is in the top-left corner.

Brains4Buildings: Knowledge platform and Roadmap for leveraging Smart Buildings

Martín Mosteiro Romero (TU Delft)

25 June 2024

Brains4Buildings

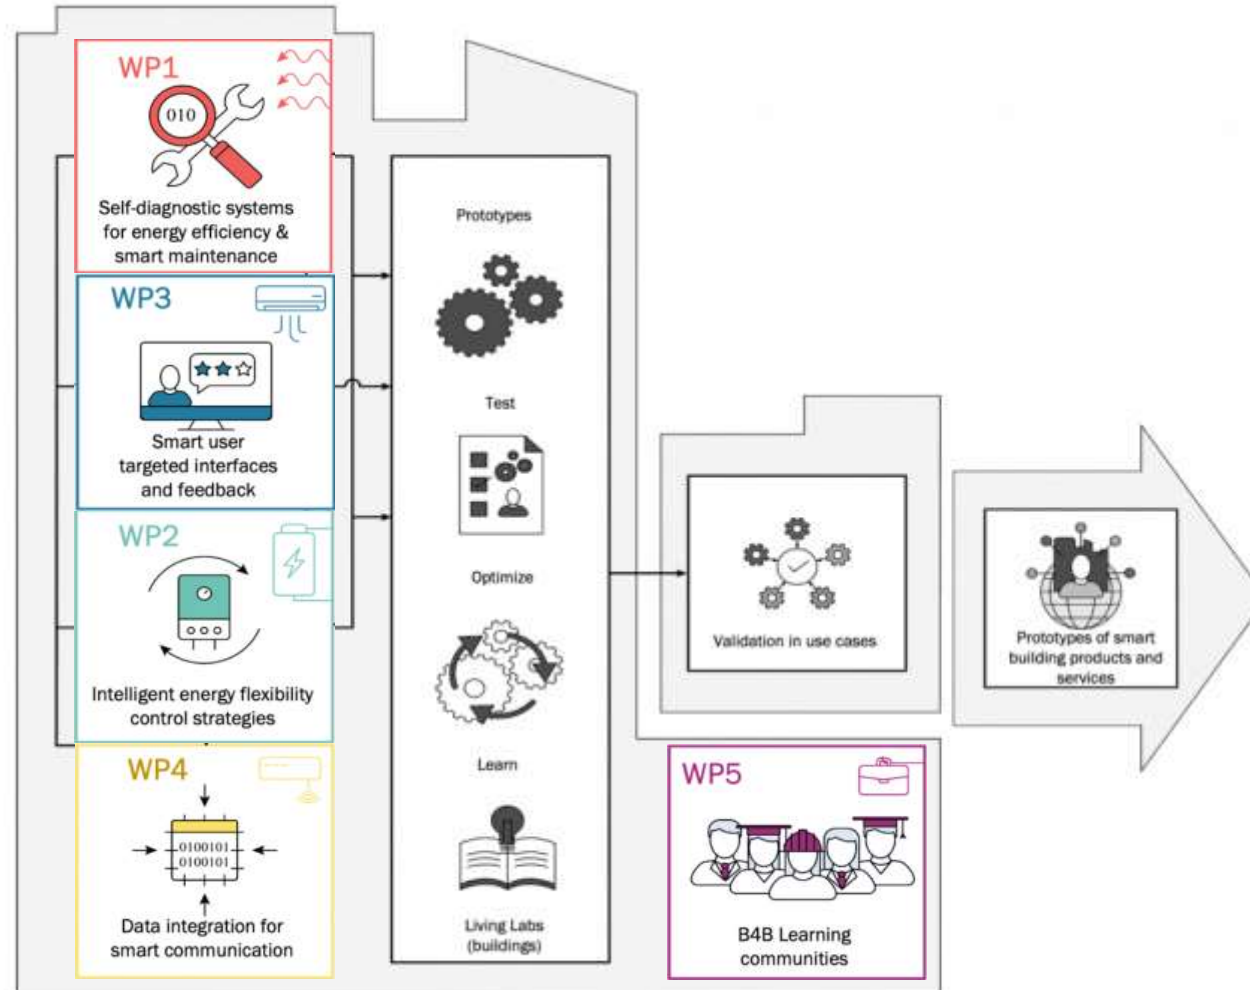



Overview Open Knowledge Platform

TU Delft TU Delft: TransACT01 Data and Machine Learning for HVAC Systems mmosteiroromer

COURSE DISCUSSION PROGRESS WHO'S WHO

Data and Machine Learning for HVAC Systems

Search the course Search Resume Course

43% complete

Expand All

- Section 1: Introduction
- Section 2: For data scientists who want to know more about HVAC systems
- Section 3: For HVAC engineers who want to know more about data analytics for building operation
- Section 4: Commissioning and quick wins in optimization of HVAC systems operation
- Section 5: In-depth look at data labelling, pre-processing & integration
- Section 6: In-depth look at Data-driven prediction of energy use
- Section 7: In-depth look at Fault Detection and Diagnosis methods for HVAC systems

Course Tools
Bookmarks

Important Course Dates
Today is Apr 22, 2024 15:34 CEST

Course Handouts
This Learning Community Site supports HVAC engineers who want to know more about the use of Building Energy Management System Data (BEMS) to optimize the operation of HVAC systems. It also aims at supporting data scientists who want to learn more on HVAC systems and want to understand BEMS data.

Open Knowledge Platform

Section 2: HVAC knowledge for data scientists



TU Delft MOOCs (4 weeks each)

ECObuild1x: Energy Demand in Buildings (started 16 April)

ECObuild2x: Energy Supply Systems for Buildings (23 April)

ECObuild3x: Comfort and Health in Buildings (starts 11 June)

ECObuild4x: Efficient HVAC Systems (16 April)



Examples

Standards

Data sources








Open Knowledge Platform

Section 3: Data science for HVAC Engineers

NUS MOOC (7 weeks)

Data Science for Construction, Architecture and Engineering



-  - Exceeding boundaries of a single screen (User needs to scroll)
-  - Fragmenting data into separate screens (multipage web apps)
-  - Displaying excessive details of precision (time up to milliseconds)
-  - Expressing measures indirectly (User needs to search for intended message)
-  - Introducing a meaningless variety
-  - Encoding quantitative data inaccurately (Bar plot: begin the scale at zero)
-  - Cluttering the display with visual effects (useless and destructing decoration)

Examples:

- Building energy prediction
- Fault Detection and Diagnosis
- Data labeling and preprocessing
- Data visualization

Open Knowledge Platform

Section 4: Commissioning & Quick Wins

Correct settings Air Handling Units

Measure	Description	Points of Attention	Comments
Make sure the inlet temperature is not higher than the room temperature. Pay attention to the setting of the Air Handling Unit.	<p>Set the maximum supply temperature (winter) back to approx. 19°C or a setting of a maximum of 18°C for the AHU from 5°C and lower, because the air still heats up through the fan and in the ducts before it reaches the grilles. Depending on the installation concept, the flow temperature at higher</p> <p>- all air constant volume with radiators (top cooling): Set 15°C at 14°C outdoors and above. The radiators can then be adjusted if they are used correctly.</p> <p>- Induction units for coil units: Set 15°C from 5°C outside. Possibly between 14°C and 20°C outside temperature, an increasing supply temperature, especially at higher</p>	<p>- In addition to a lot of energy savings, this measure results in (much) better comfort for offices, education and meetings.</p> <p>- Indoor rooms can become colder if there is no additional heating. Installing an (electric) heating element solves this. This usually does not concern workplaces because daylight is lacking in those indoor spaces. This can also be accepted for consultation or meeting functions, or short-term electrical heating will suffice.</p> <p>- Make sure that any dew point controls are functioning properly to prevent surface condensation.</p> <p>- Use as little as possible so-called compensation controls on the control</p>	<p>It does not matter whether the air in the rooms is heated by the local heating system or the air handling unit. That goes against the feeling, but quickly turns out to be correct if you think about it for a while. It is true that a higher inlet temperature than necessary results in unnecessary heating of the ventilation air.</p>  <p>The internal heat production and/or solar radiation is often more than sufficient to heat well-insulated buildings during a large part of the</p>

Tips and Tricks about setpoints (Ed Rooijackers)



Standards:

- ISSO 107




Open Knowledge Platform

Section 5: Data labelling, pre-processing and integration







Open Knowledge Platform

Section 6: Data-driven demand prediction

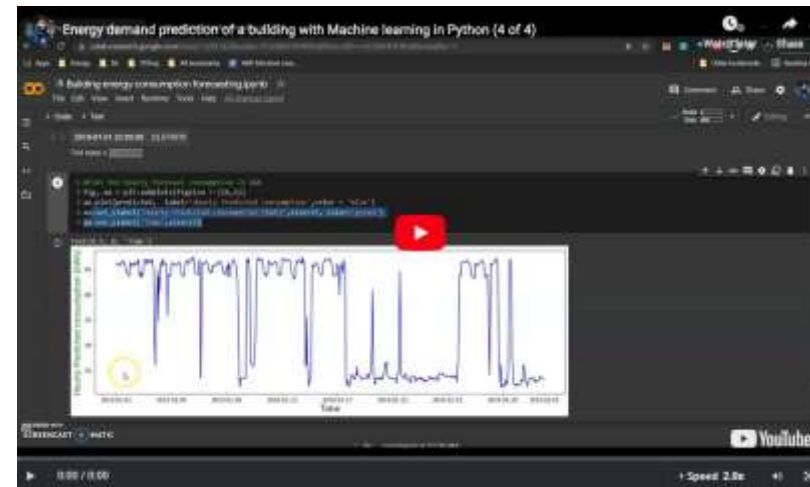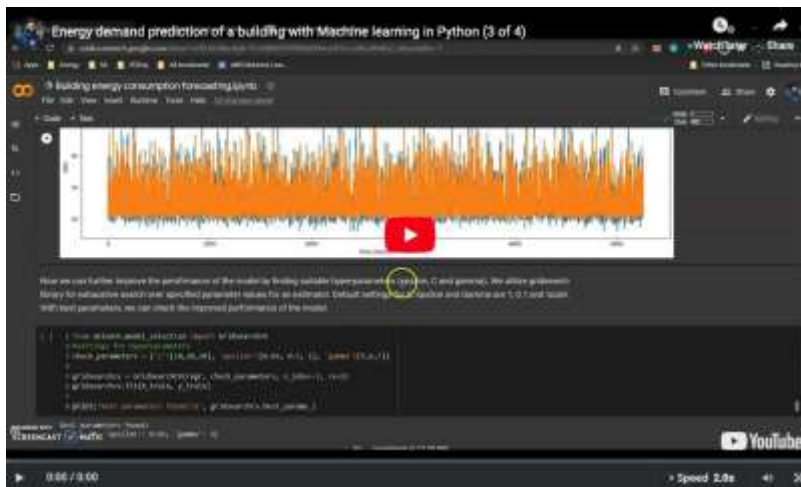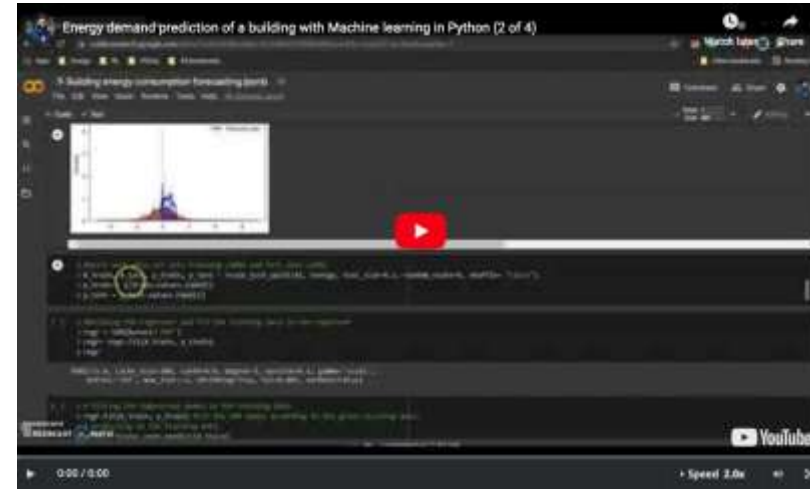


Open Knowledge Platform

Section 7: Fault Detection and Diagnosis
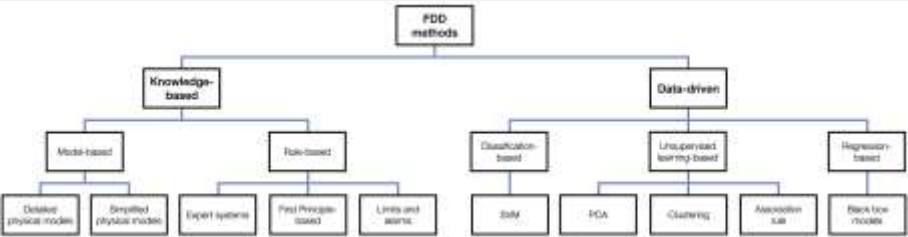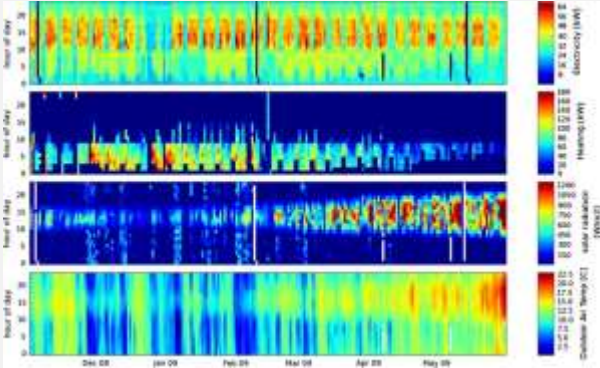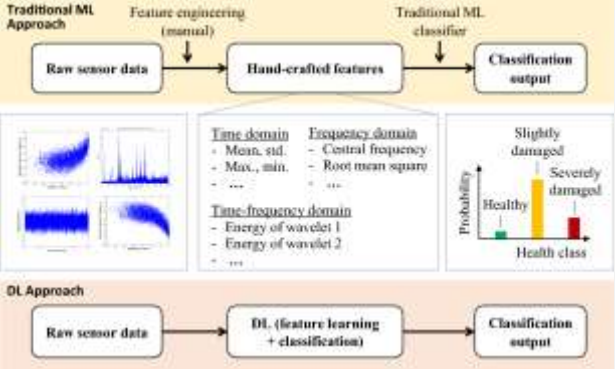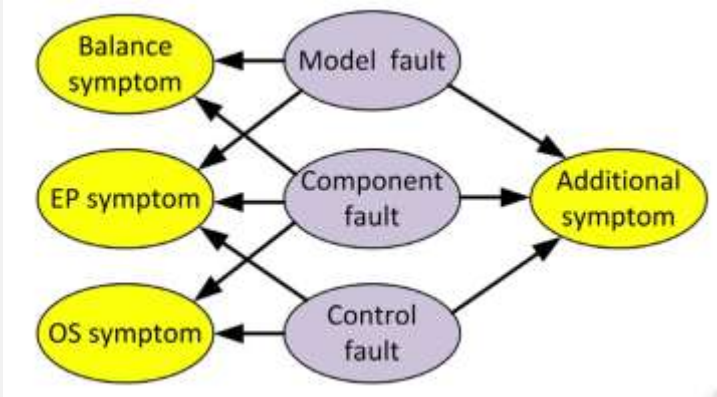
<p style="writing-mode: vertical-rl; transform: rotate(180deg);">Classification</p>  <p>The diagram shows 'FDD methods' branching into 'Knowledge-based' and 'Data-driven'. 'Knowledge-based' includes 'Model-based' (Detailed physical models, Simplified physical models) and 'Rule-based' (Expert systems, Fuzzy logic-based, Limits and alarms). 'Data-driven' includes 'Classification-based' (SVM, PCA), 'Unsupervised learning-based' (Clustering, Association rule), and 'Regression-based' (Black box models).</p>	<p style="writing-mode: vertical-rl; transform: rotate(180deg);">Pattern-based</p>  <p>The spectrograms show 'Hour of day' on the y-axis and time from Dec 08 to May 09 on the x-axis. The top plot is 'Acoustic (dB)', the second is 'Humidity (mm)', the third is 'Solar radiation (W/m²)', and the bottom is 'Outdoor Air Temp (°C)'. Each plot shows distinct patterns of activity over time.</p>
<p style="writing-mode: vertical-rl; transform: rotate(180deg);">ML-based</p>  <p>The diagram compares two approaches. The 'Traditional ML Approach' involves 'Raw sensor data' → 'Feature engineering (manual)' → 'Hand-crafted features' → 'Traditional ML classifier' → 'Classification output'. It lists features like 'Time domain' (Mean, std, Max, min), 'Frequency domain' (Central frequency, Root mean square), and 'Time-frequency domain' (Energy of wavelet 1, Energy of wavelet 2). A bar chart shows 'Health class' with 'Slightly damaged' and 'Severely damaged' categories. The 'DL Approach' involves 'Raw sensor data' → 'DL (feature learning + classification)' → 'Classification output'.</p>	<p style="writing-mode: vertical-rl; transform: rotate(180deg);">Bayesian networks</p>  <p>The Bayesian network shows nodes for 'Balance symptom', 'EP symptom', 'OS symptom', 'Model fault', 'Component fault', 'Control fault', and 'Additional symptom'. Arrows indicate dependencies: 'Model fault', 'Component fault', and 'Control fault' all influence 'Balance symptom', 'EP symptom', and 'OS symptom'. 'Component fault' and 'Control fault' also influence 'Additional symptom'.</p>

Open Knowledge Platform

Section 7: Fault Detection and Diagnosis

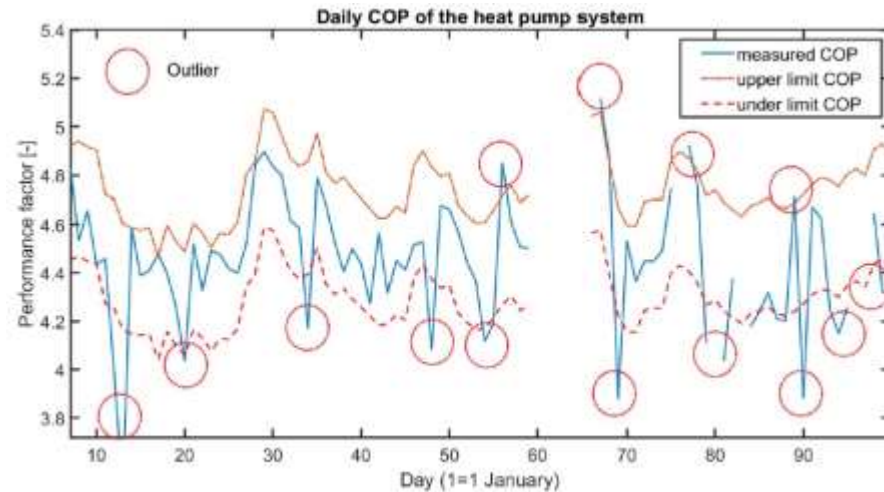

Examples:

- Diagnostic Bayesian Networks
- 4S3F



Standards
Data sources



Roadmap for leveraging Smart Buildings

A practical roadmap for achieving asset management goals through data-driven building solutions

The goal of this roadmap is:

1. create **awareness** about the current challenges in the industry and how they can be tackled with data-driven solutions, and alternatively, how they can be tackled with low-tech solutions
2. to **illustrate** that a smart building is a tool (and not a goal in itself) to achieve a (set of) predefined asset management goal(s)
3. to provide a **practical step-by-step guideline** for achieving data integration to the different stakeholders involved in the value chain of smart buildings








Evaluate

Improve

Integrate (1)

Extend

Integrate (2)

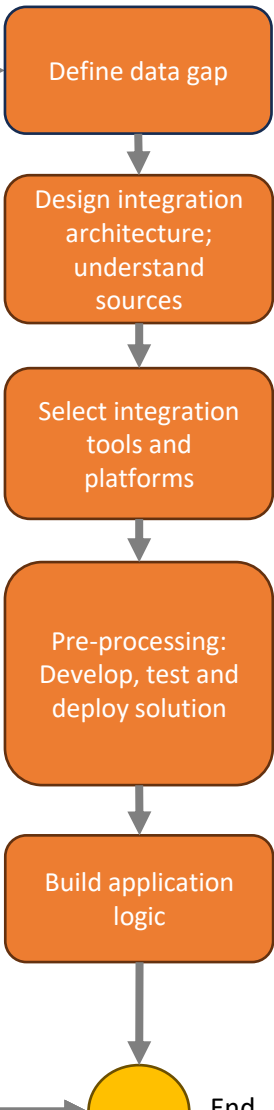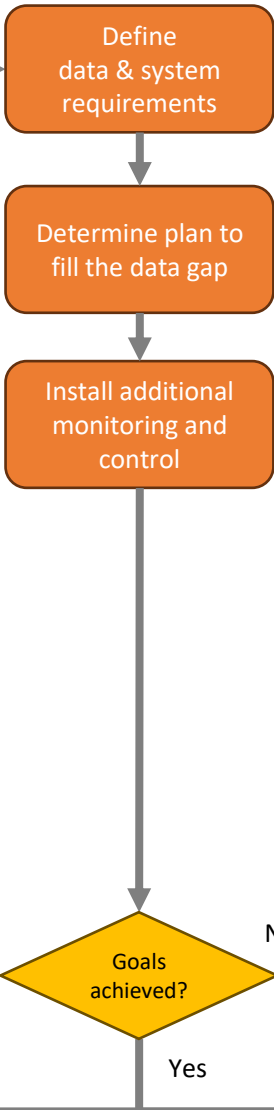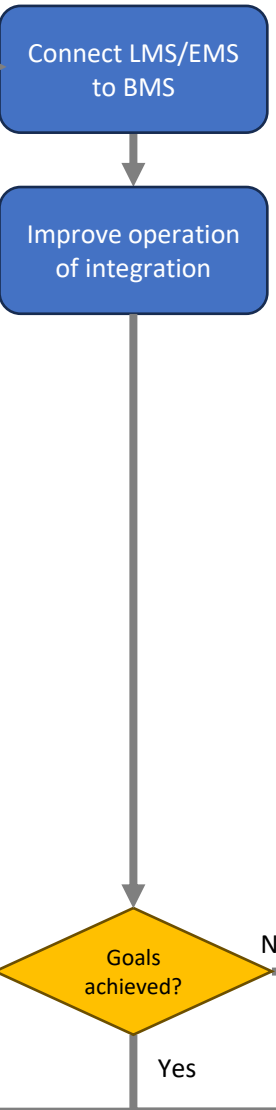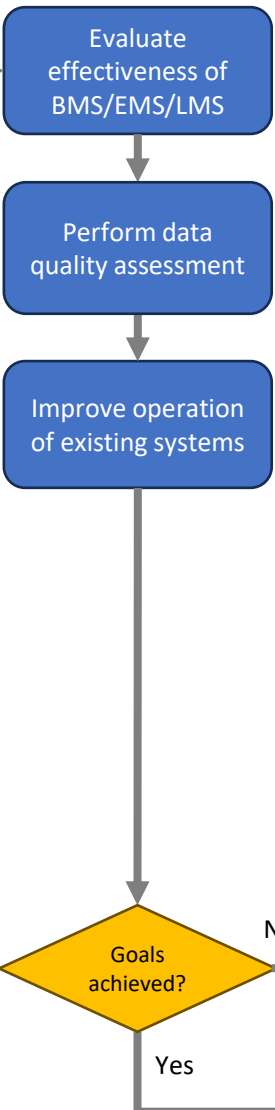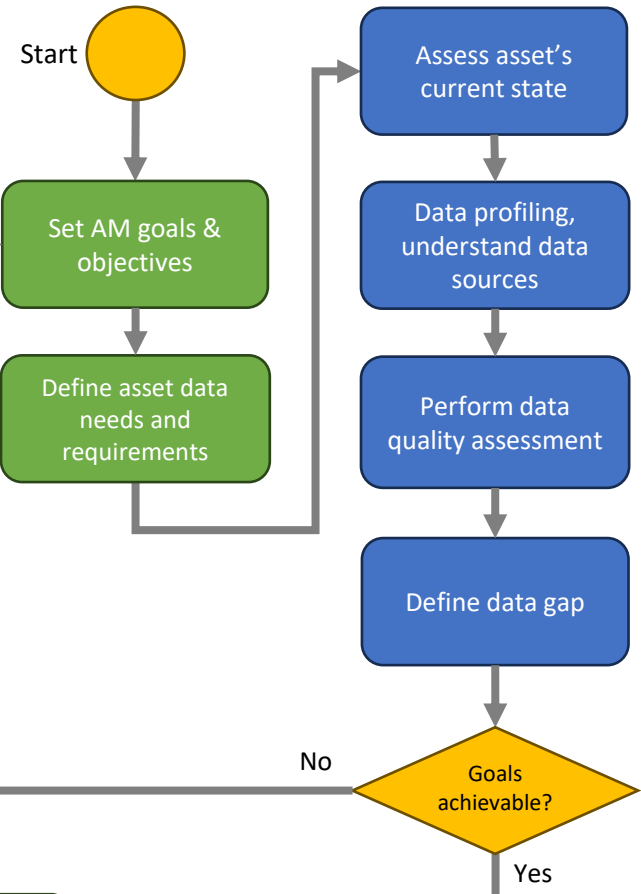




Legend


- Goals (Green box)
- Existing systems (Blue box)
- New systems (Orange box)

Stakeholder reading guide



 A: Complex / high tech		Integrate		Integrate	
 B: Normal / mid-level	Integrate	Improve	Improve	Improve	Improve
 C: Simple / low tech			Evaluate	Evaluate	
	Academics & researchers	Product developers & consultants (Services & products)	Real estate owners (Strategic)	Building- & facility managers (Tactical)	Installers & technicians (Operational)

DGBC Knowledge Hub

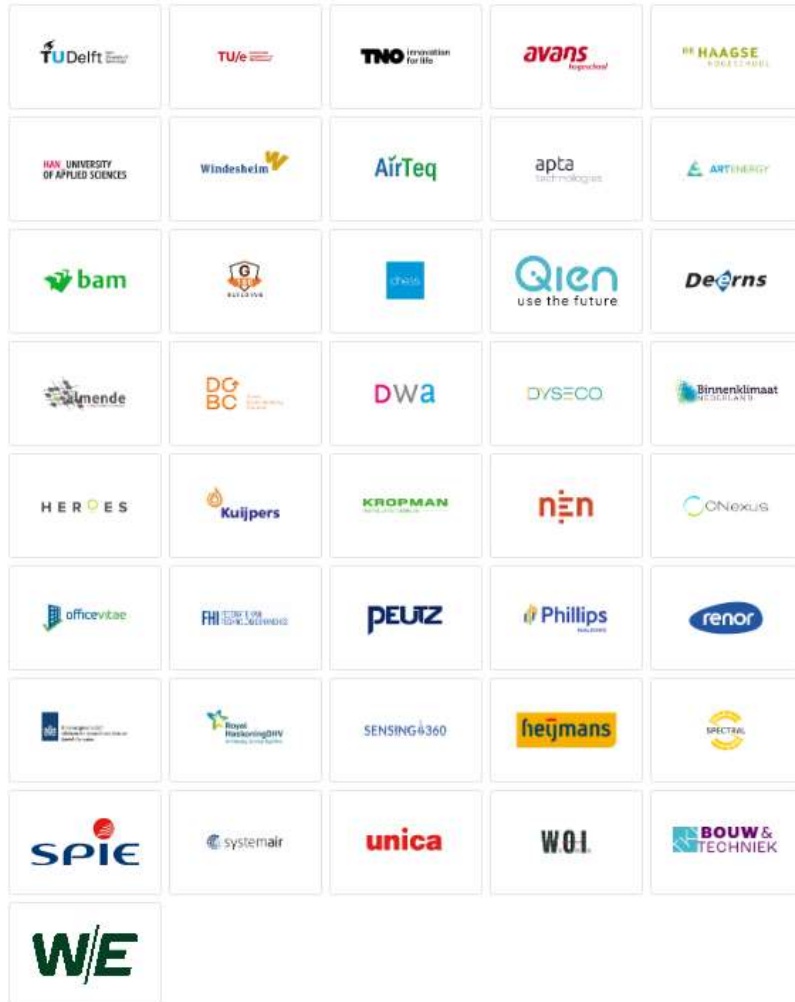

Living Labs
Deliverables
Shared Resources
Website
Articles
Congresses
Webinars
...

Knowledge transfer

What's happening out there?



DGBC Knowledge Hub



Sustainable
Construction
Library

LIVE

Toolbox for
CO₂ Reduction

LIVE

Knowledge
Platform

LIVE

Learning
Tracks

LIVE

PLANNED



A photograph of a modern glass building with a network diagram overlay. The diagram consists of light blue circles connected by thin lines, forming a complex web. The building has a curved facade and is surrounded by greenery and a body of water in the foreground. A dark green triangle is in the top-left corner.

Thank you!

Martín Mosteiro Romero (TU Delft)

25 June 2024